


SERVICES LEGEND

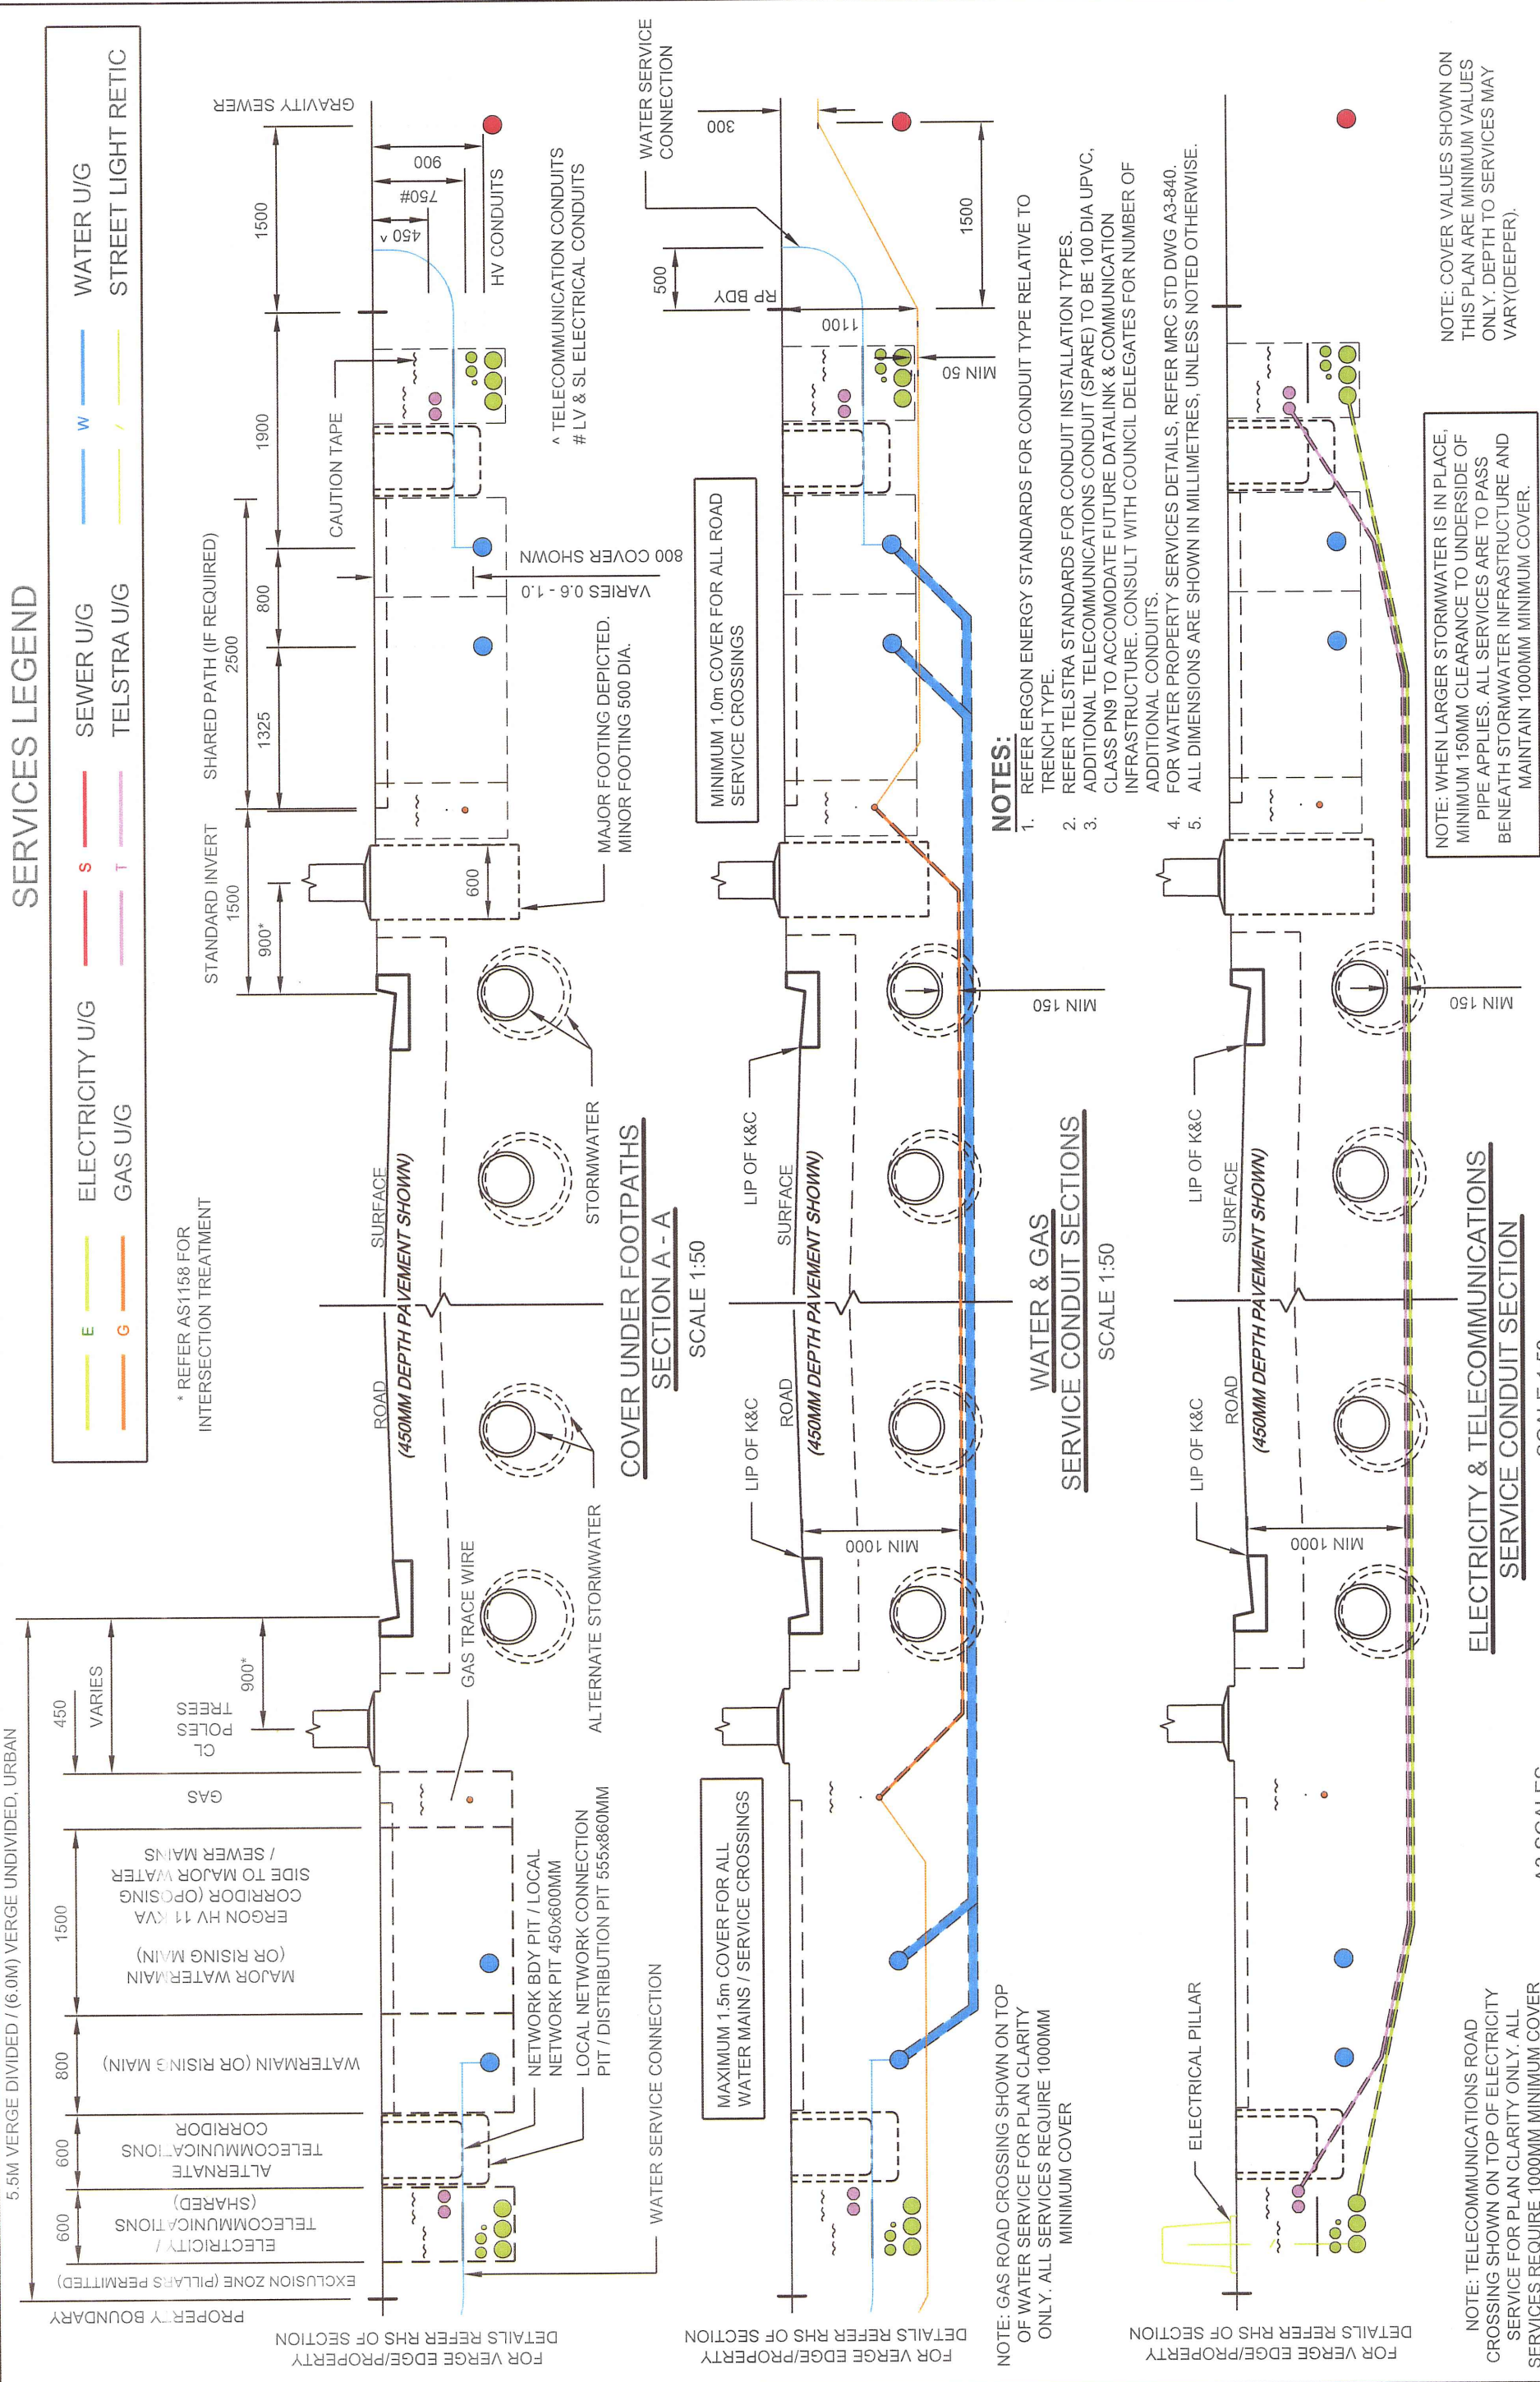

NOTE: COVER VALUES SHOWN ON THIS PLAN ARE MINIMUM VALUES ONLY. DEPTH TO SERVICES MAY VARY (DEEPER).

NOTE: WHEN LARGER STORMWATER IS IN PLACE, MINIMUM 150MM CLEARANCE TO UNDERSIDE OF PIPE APPLIES. ALL SERVICES ARE TO PASS BENEATH STORMWATER INFRASTRUCTURE AND MAINTAIN 1000MM MINIMUM COVER.

ELECTRICITY & TELECOMMUNICATIONS SERVICE CONDUIT SECTION

SCALE 1:50

A3 SCALES

STANDARD				SHEET 2 OF 3	
SERVICE CORRIDORS SECTION & ROAD CROSSINGS				WORKS JOB No. -	
5.5M VERGE DIVIDED & 6.0M VERGE UNDIVIDED, URBAN				DRAWING No. A3-886	
SHEET 2 OF 3				AMEND. A	
Mackay REGIONAL COUNCIL				DIRECTOR ENGINEERING SERVICES	
S.M. HILL				STUART HOLLEY RPEQ 894	
DATE 25.7.12				DATE 12/7/12	
G. HAVES RPEQ 5693				MANAGER TECHNICAL SERVICES	
SURVEY				DRAWN	
SURVEY FILE No				DESIGNED	
LEVEL DATUM				CHECKED	
MERIDIAN				APPROVED	
AMENDMENTS AND REVISIONS				DESCRIPTION	
FILE NAME: STANDARD DRAWINGS/SERVICE CORRIDORS/A3-886.DWG				DATE	
ORIGINAL ISSUE				NO.	