

NOTES:

1. REINFORCING MESH TO COMPLY WITH AS4671, SL72 LAP MESH 400mm, 50mm TOP AND EDGE COVER, UNLESS OTHERWISE SPECIFIED.
2. REINFORCEMENT BAR CHAIRS ARE TO BE USED TO ACCURATELY LOCATE MESH. PLACE CHAIRS AT 500mm MAXIMUM CENTRES IN A TRIANGULAR PATTERN.
3. EXPANSION JOINTS INSTALLED AT A MAXIMUM 9000mm CENTRES TOOLED CONTROL JOINTS INSTALLED AT MAXIMUM 3000mm CENTRES.
4. DOWELS TO BE 12 DIA GALVANISED STEEL BARS, GRADE 250R, 300mm LONG AT 300 CENTRES. GREASE ONE END OF DOWEL & ATTACH DOWEL CAP.
5. CONCRETE N32 TO BE USED AND COMPLY WITH AS1379 AND AS3600, WITH SLUMP OF 70 TO 90mm, UNLESS OTHERWISE SPECIFIED, TOGETHER WITH MRS03, MRS07 & RELEVANT MRC SUPPLEMENTARY SPECIFICATIONS.
6. ALL CONCRETE SHALL BE SPRAYED WITH AN APPROVED CURING PRODUCT AND BROOM FINISHED.
7. FINISHED SURFACE TOLERANCE TO BE MAXIMUM 0-6mm RELATIVE TO KERB LEVEL AND CROSS FALL SPECIFIED SO AS WATER WILL NOT POND.
8. PLACE MINIMUM 50mm OF TOPSOIL AND TURF TO DISTURBED AREAS ADJOINING NEW CONCRETE FOOTPATHS WHERE TURF ALLOWED FOR. REINSTATED AREAS ARE TO BE GRADED EVENLY. CRUSHER DUST IS NOT TO BE USED FOR REINSTATEMENT WORKS.
9. TREE PRUNING IS TO BE CARRIED OUT BY MRC QUALIFIED ARBORIST ONLY.
10. REFER MRC LIST OF PLANT SPECIES FOR COUNCIL APPROVED STREET TREES. ALTERNATIVE SPECIES ARE NOT PERMISSABLE WITHOUT PRIOR COUNCIL APPROVAL.
11. SV & FH SURFACE BOXES TO BE INSTALLED/REINSTATED IN ACCORDANCE WITH AMENDMENT TABLE D11.01 OF PLANNING SCHEME POLICY 15.12.
12. ALL DIMENSIONS IN MILLIMETRES UNLESS NOTED OTHERWISE.
13. LOCATIONS OF LATERAL STENCILLED BANDS AS SHOWN ARE FOR TYPICAL SITUATIONS WHERE FOOTPATHS ABUT FENCELINES AND PROPERTY BOUNDARIES. WHERE FOOTPATHS ABUT BUILDINGS, POSITION OF LATERAL PAVEMENT BANDS SHOULD ALIGN WITH AND REFLECT EXPRESSED ARCHITECTURAL FEATURES OF BUILDING. FEATURES MAY INCLUDE: CORNERS, FAÇADE RETURNS, ENTRANCES, STRUCTURAL COLUMNS, AWNING POSTS AND OTHER PROMINENT FEATURES.

THIS TREATMENT IS TO BE APPLIED TO ALL 'PRINCIPAL CENTRE', 'MAJOR CENTRE', 'DISTRICT CENTRE' AND 'LOCAL CENTRE' ZONE FRONTAGES OUTSIDE THE MACKAY CENTRAL BUSINESS DISTRICT (REFER STD DWG A3-00989)

APPLICATION TO 'MIXED USE' ZONE FRONTAGES TO BE REFERRED TO ???


300mm x 300mm STENCILLED TILE SPRAY ON TREATMENT. 2 COATS OF COLOURED 'CHARCOAL' MEETING THE REQUIREMENTS OF 'N65 GRAPHITY GRAY', IN ACCORDANCE WITH AS2700. TWO COATS OF APPROVED POLYMER SEALER TO BE APPLIED FOLLOWING INITIAL CURING OF OCHRE SURFACE.

900 WIDE TURF STRIP TO BACK OF KERB, LENGTH VARIES, TREES MAY BE PLANTED WITHIN THIS STRIP. THE USE OF A TURF STRIP DEPENDS ON EXPECTED PEDESTRIAN VOLUMES

SURFACE FINISH TO A.S. 3661.1:1993 FOR SLIP FINISH FRICTION FACTOR 0.75

AN ALLOWANCE IS TO BE MADE FOR A SEAT AND BIN. FINAL LOCATION AND NUMBERS WILL BE AT THE DISCRETION OF MRC

DO NOT APPLY STENCILLED TILE TREATMENT AROUND KERB RAMPS. TREATMENT TO BE AS SHOWN AND FOLLOW THE PROPERTY LINE ONLY

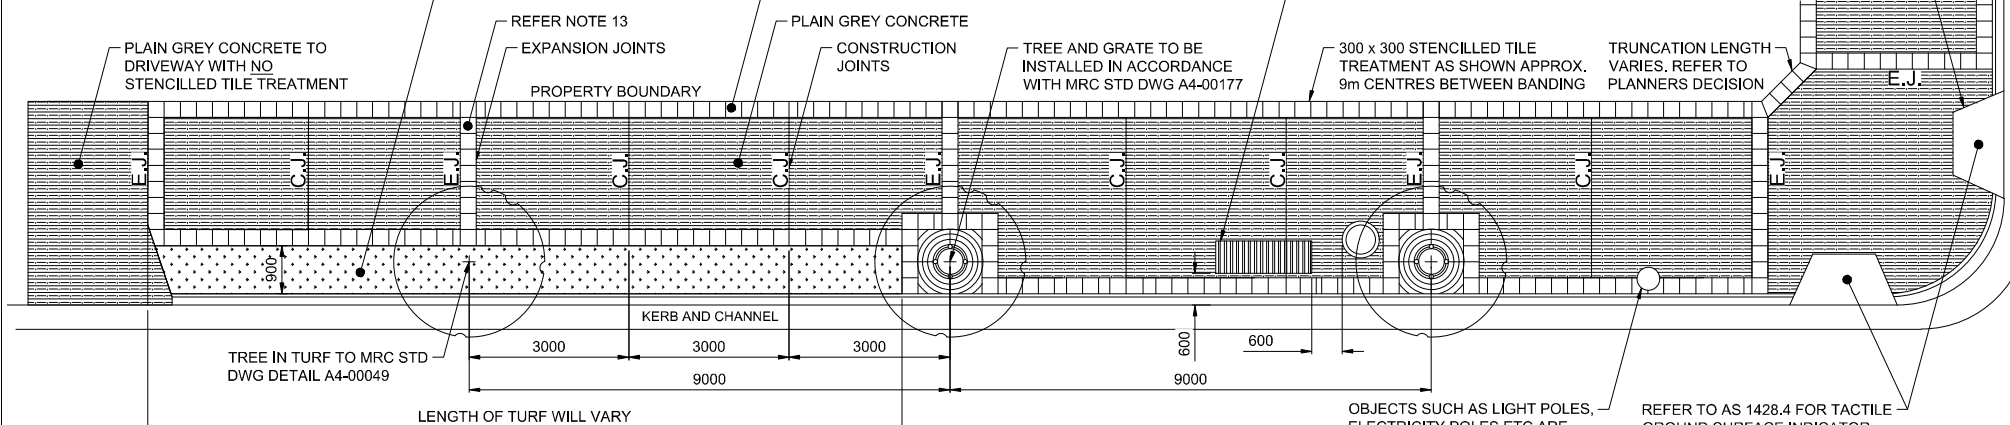

INDICATIVE PLAN

1 : 100

			SURVEY	DRAWN	SIGNED	DATE
C	05/2020	REVISION TO BE ADVISED	JC	APC	A.CHRISTENSEN	20.05.16
B	23.02.17	NOTE 5 AMENDED		DESIGNED	SIGNED	DATE
A	-	ORIGINAL ISSUE	-	CHECKED	SIGNED	DATE
DATE	DESCRIPTION	APPVD	LEVEL DATUM	F.KROLL	F.KROLL	20.05.16
AMENDMENTS AND REVISIONS			MANAGER TECHNICAL SERVICES			
STANDARD DRAWINGS/FOOTPATHS			MERIDIAN	ORIGINAL SIGNED BY G.HAWES		
				G. HAWES RPEQ 5693		
				DATE		

DIRECTOR
ENGINEERING AND
COMMERCIAL INFRASTRUCTURE

ORIGINAL SIGNED BY J.DEVITT
JASON DEVITT

DATE 20.05.16



STANDARD FOOTPATH TREATMENT TO CBD PERIPHERY ZONES

SHEET 1 OF 1

WORKS JOB No.

DRAWING No.

A3-00848

AMEND.

C