



**SERVICES LEGEND**

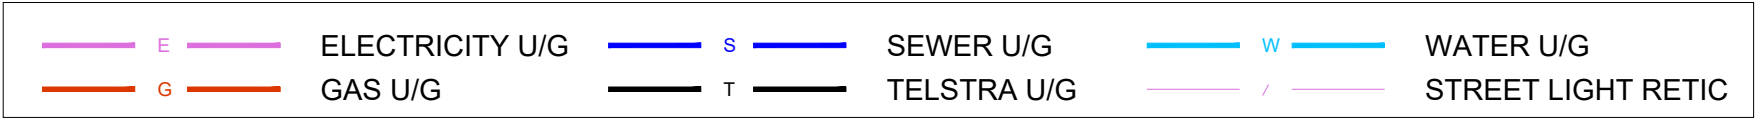


\* REFER AS1158 FOR INTERSECTION TREATMENT

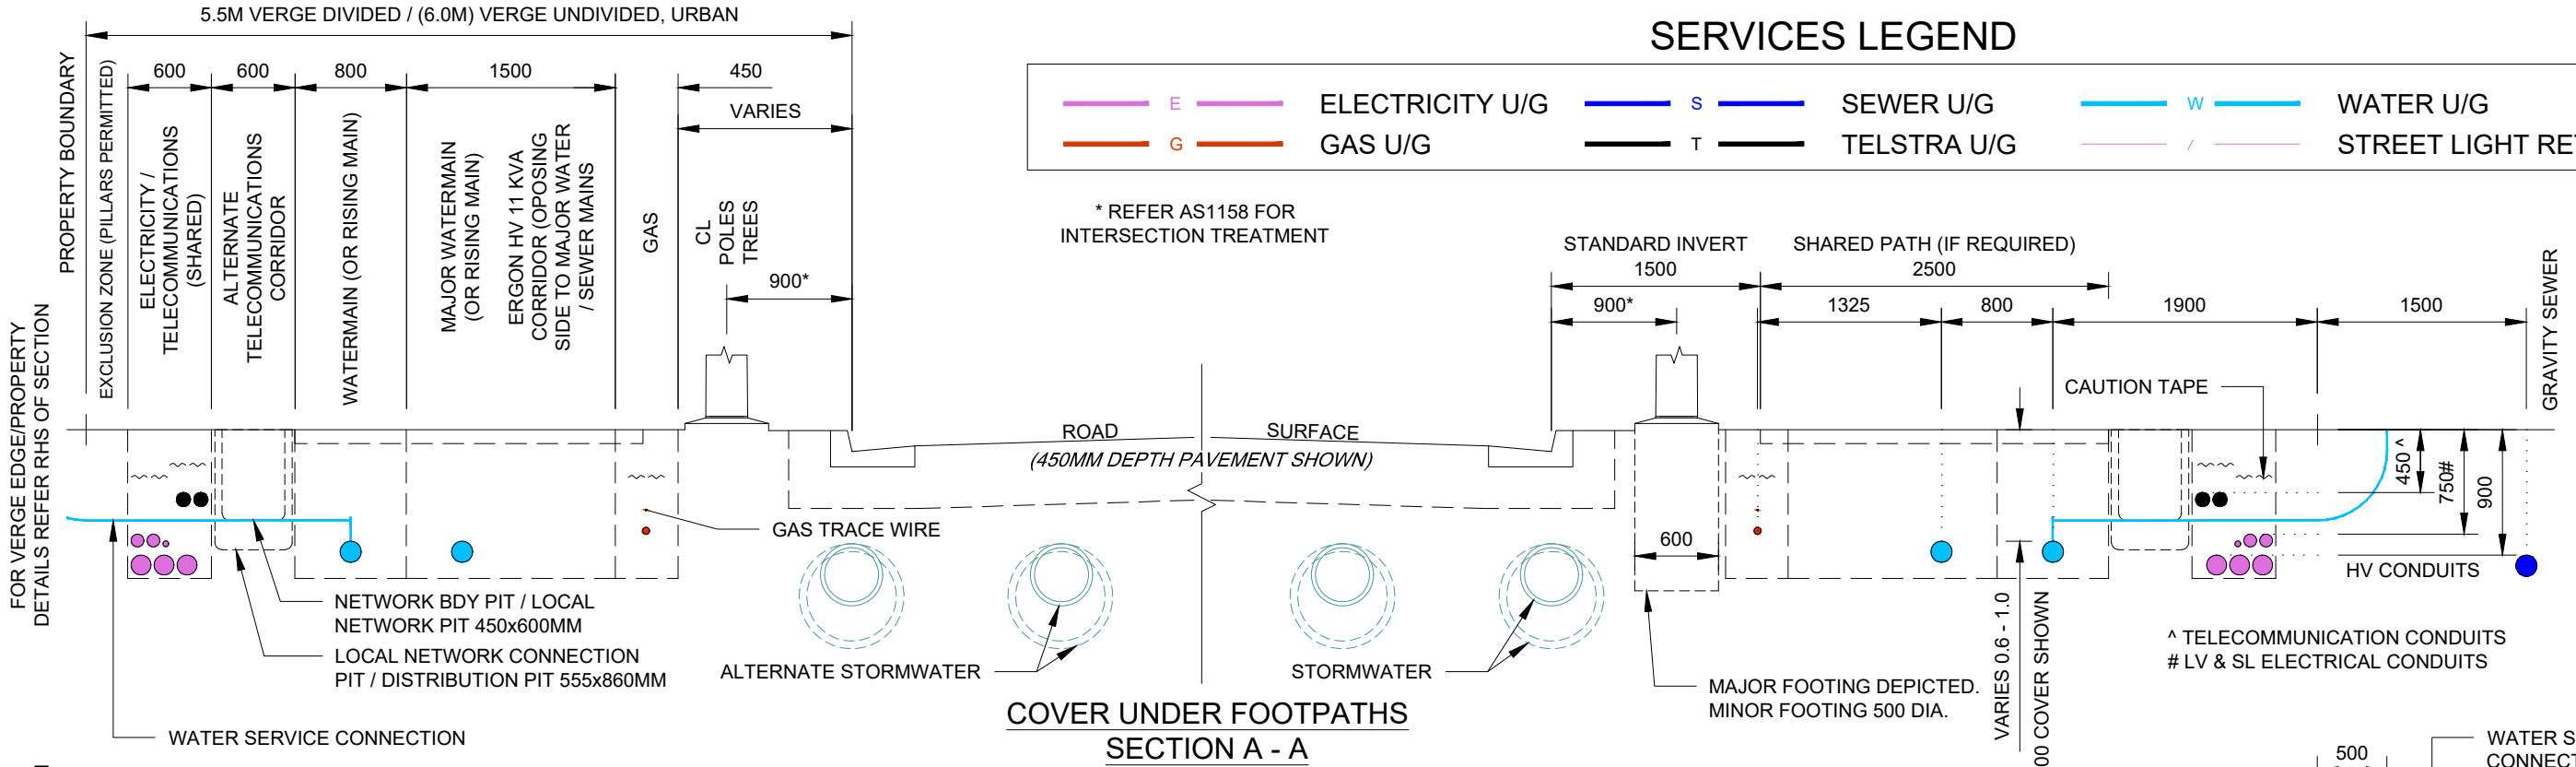


**COVER UNDER FOOTPATHS**  
**SECTION A - A**

SCALE 1:50

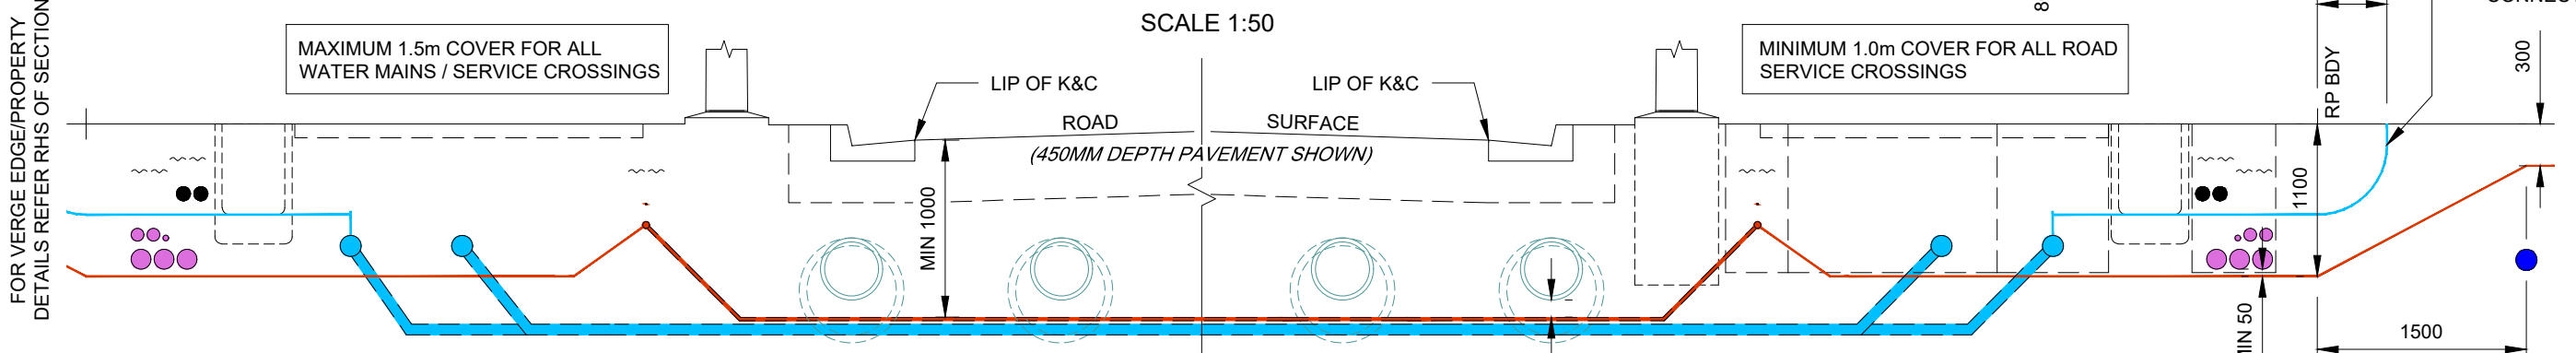

**WATER & GAS SERVICE CONDUIT SECTIONS**

SCALE 1:50

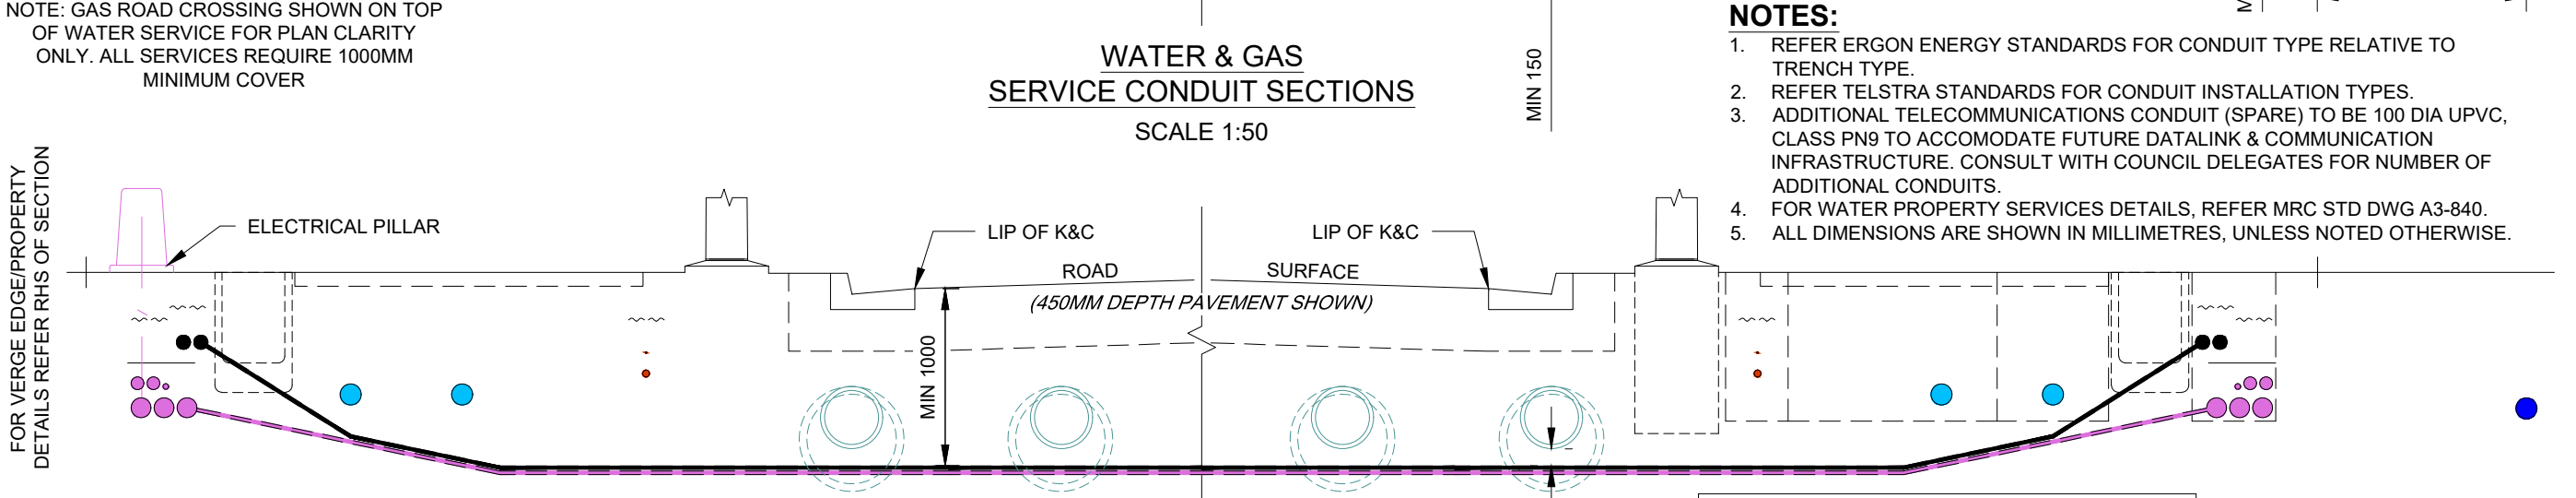

**ELECTRICITY & TELECOMMUNICATIONS SERVICE CONDUIT SECTION**

SCALE 1:50

NOTE: GAS ROAD CROSSING SHOWN ON TOP OF WATER SERVICE FOR PLAN CLARITY ONLY. ALL SERVICES REQUIRE 1000MM MINIMUM COVER

NOTE: TELECOMMUNICATIONS ROAD CROSSING SHOWN ON TOP OF ELECTRICITY SERVICE FOR PLAN CLARITY ONLY. ALL SERVICES REQUIRE 1000MM MINIMUM COVER

- NOTES:**
- REFER ERGON ENERGY STANDARDS FOR CONDUIT TYPE RELATIVE TO TRENCH TYPE.
  - REFER TELSTRA STANDARDS FOR CONDUIT INSTALLATION TYPES.
  - ADDITIONAL TELECOMMUNICATIONS CONDUIT (SPARE) TO BE 100 DIA UPVC, CLASS PN9 TO ACCOMMODATE FUTURE DATALINK & COMMUNICATION INFRASTRUCTURE. CONSULT WITH COUNCIL DELEGATES FOR NUMBER OF ADDITIONAL CONDUITS.
  - FOR WATER PROPERTY SERVICES DETAILS, REFER MRC STD DWG A3-840.
  - ALL DIMENSIONS ARE SHOWN IN MILLIMETRES, UNLESS NOTED OTHERWISE.

NOTE: WHEN LARGER STORMWATER IS IN PLACE, MINIMUM 150MM CLEARANCE TO UNDERSIDE OF PIPE APPLIES. ALL SERVICES ARE TO PASS BENEATH STORMWATER INFRASTRUCTURE AND MAINTAIN 1000MM MINIMUM COVER.

NOTE: COVER VALUES SHOWN ON THIS PLAN ARE MINIMUM VALUES ONLY. DEPTH TO SERVICES MAY VARY(DEEPER).

A3 SCALES

B	12/18	COLOURS REVISED FOR SERVICES	GH
A	-	ORIGINAL ISSUE	-
NO.	DATE	DESCRIPTION	APPVD
AMENDMENTS AND REVISIONS			
FILE NAME	I STANDARD DRAWINGS\A3-00886.DWG		

SURVEY	DRAWN	SIGNED	DATE	DIRECTOR ENGINEERING SERVICES
-	DESIGNED	SIGNED	DATE	ORIGINAL SIGNED BY STUART HOLLEY RPEQ 8940
SURVEY FILE No	CHECKED	SIGNED	DATE	DATE 20.7.12
-	MANAGER TECHNICAL SERVICES			18/7/12
LEVEL DATUM	ORIGINAL SIGNED BY G. HAWES RPEQ 5693			DATE
-				

**Mackay REGIONAL COUNCIL**

**STANDARD SERVICE CORRIDORS SECTION & ROAD CROSSINGS**  
5.5M VERGE DIVIDED & 6.0M VERGE UNDIVIDED, URBAN  
SHEET 2 OF 3

SHEET 2 OF 3	
WORKS JOB No. -	
DRAWING No. A3-00886	AMEND. B