



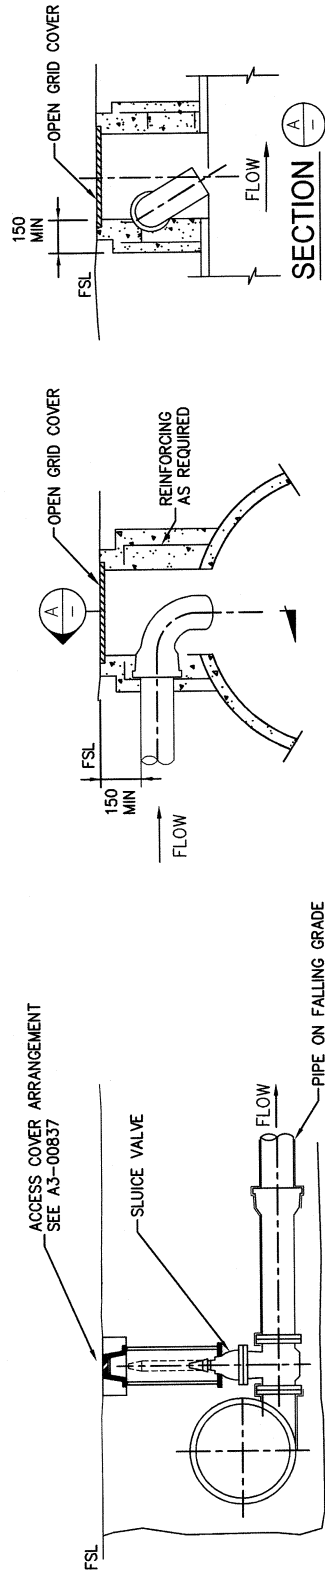

SCOUR DISCHARGE TO APPROVED DRAINAGE SYSTEM

SCOUR CONNECTION DETAIL

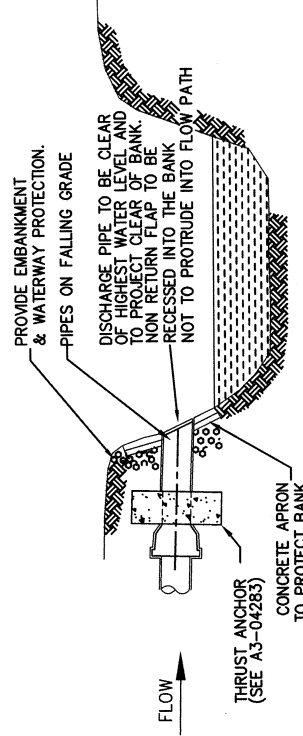

SCOUR DISCHARGE TO STORAGE LAGOON

NOTES:

1. ALL DIMENSIONS IN MILLIMETRES.
2. SCOUR VALVE AND PIPEWORK TO MATCH REQUIRED DISCHARGE RATE.
3. OBTAIN MACKAY WATER & WASTE APPROVAL FOR SUMP &/OR DISCHARGE POINT PRIOR TO CONSTRUCTION OF SCOUR.
4. UNREINFORCED CONCRETE TO BE N20 AND REINFORCED CONCRETE N25.
5. PROVIDE CORROSION PROTECTION FOR PIPEWORK AND FITTINGS.

SCOUR DISCHARGE
COLLECTION / PUMP-OUT SUMP

MRC STANDARD DRAWINGS SUPERCEDES WSAA STANDARD DRAWINGS

DRAWING FILE NAME M:\Engineering Services\Technical Services\Design\Projects\Standard drawings\Mackay Water\WSAA MRC\WAT CODE\A3-042988				COMMERCIAL SERVICES		Mackay REGIONAL COUNCIL	
C 5/9	AMEND	MGP	Sign.	JC	EXECUTIVE MANAGER MACKAY WATER & WASTE RPEQ 7506		STANDARD DRAWING TYPICAL APPURTENANCE INSTALLATION
B MAY08	MODIFIED TO MRC STD	SUR	SUR		DATE 27 MAY09		DRAWING No. A3-042988
A OCT07	TSFER TO MRC TBLOCK	SUR			DATE OF LAST EDIT May 21, 2009		AMEND. C
0	WSAA ORIG.				JOB No MGA-55		SCOUR ARRANGEMENTS
NO.	DATE	DESCRIPTION	APPVD.	MERIDIAN	WATER SERVICES ASSOCIATION of Australia		SHEET 1 OF 1