



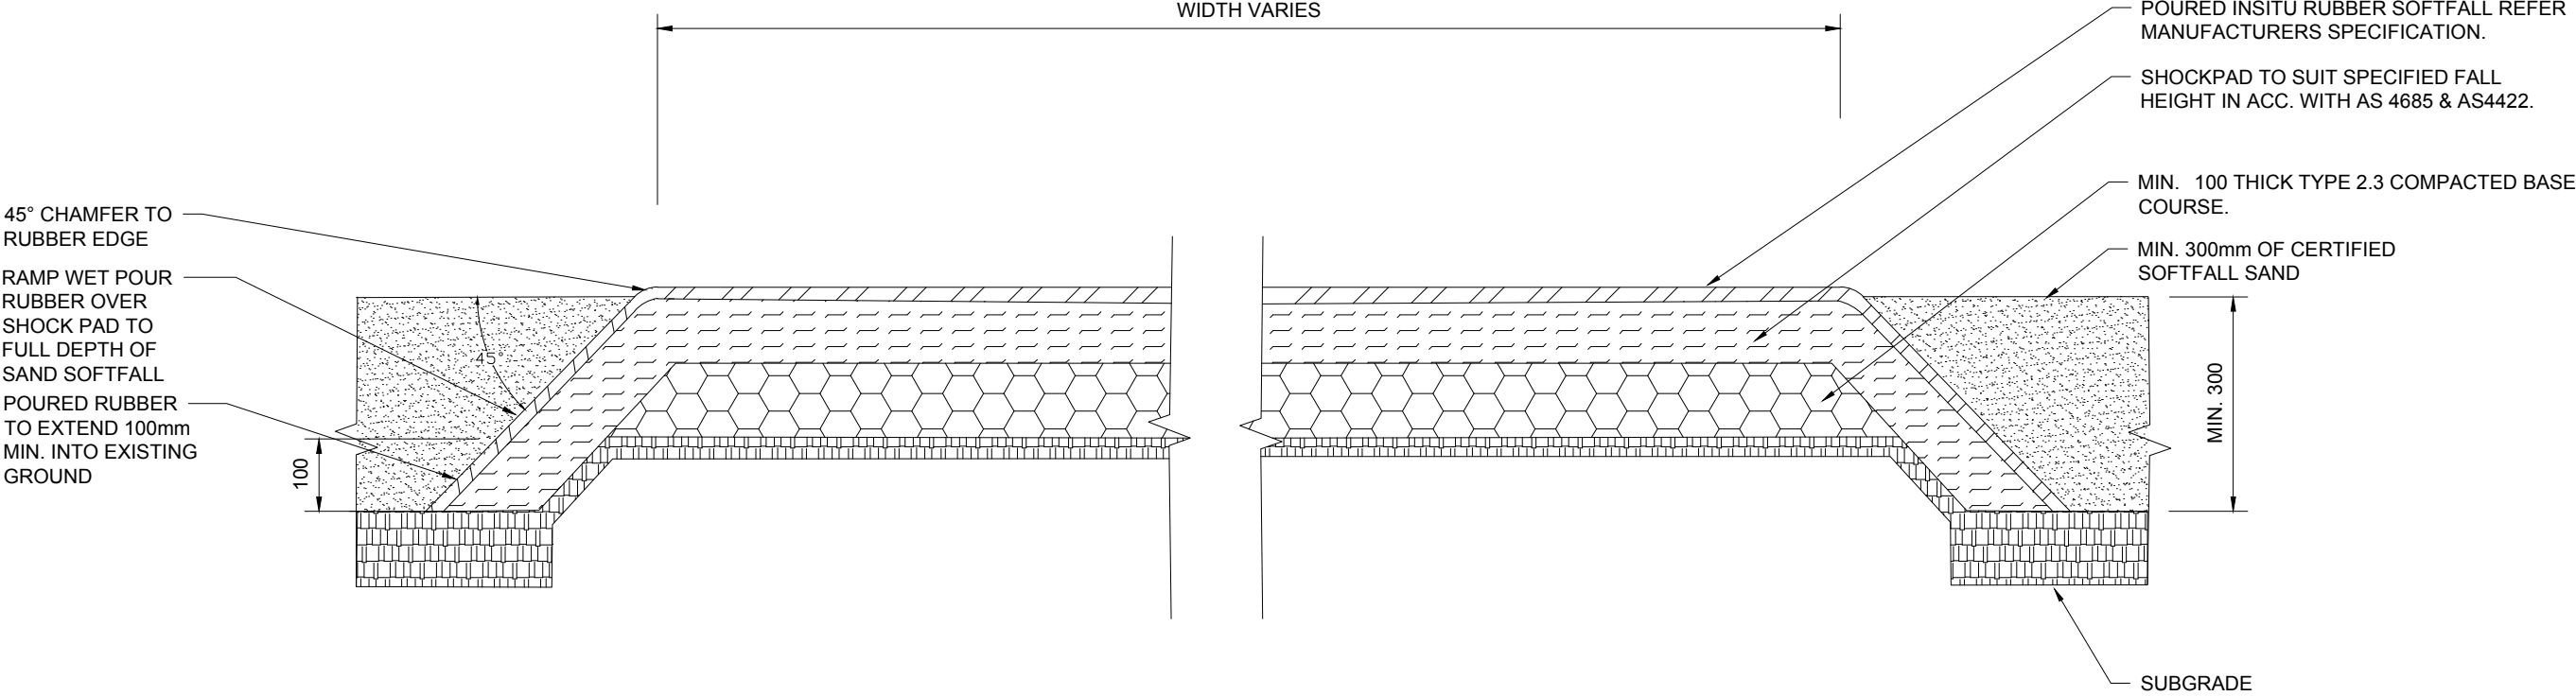

PLAYGROUND POURED RUBBER PAD
SCALE 1:10

- NOTES:
- ALL DIMENSIONS IN MILLIMETERS UNLESS NOTED OTHERWISE.
 - EXISTING SUBGRADE TO BE COMPACTED TO 95% MMDD. WHERE THE EXISTING SUBGRADE IS NOT SUITABLE FOR COMPACTION, EXCAVATE AND REPLACE WITH SUITABLE FILL MATERIAL TO ACHIEVE THE SPECIFIED COMPACTION RATE.
 - RUBBER SOFTFALL TO BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS' SPECIFICATIONS TO MEET THE REQUIREMENTS OF THE EQUIPMENT FALL ZONES.
 - ALL RUBBER SOFTFALL SURFACING TO BE COMPLIANT WITH AS4685 & AS4422. CERTIFICATION OF INSTALLATION SUPPLIED UPON COMPLETION.
 - SHOCKPAD THICKNESS TO BE SIZED TO ACHIEVE THE REQUIRED IMPACT ATTENUATION TO COMPLY WITH AS4422 FOR CRITICAL FALL HEIGHT OF PLAY EQUIPMENT INSTALLED WITHIN SOFTFALL AREA + 30%. THE REQUIREMENT TO EXCEED THE SPECIFIED PLAY EQUIPMENT'S CRITICAL FALL HEIGHT BY 30% IS TO ALLOW FOR COMPACTION OF THE SURFACE OVER TIME. WHERE APPROPRIATE, THE DESIGN OF THE SOFTFALL SURFACE MAY CALL FOR A UNIFORM THICKNESS OF SHOCKPADS OVER NOMINATED SECTIONS WITHIN SOFTFALL AREA PROVIDED COMPLIANCE WITH AS4422 + 30% CONTINUES TO BE ACHIEVED FOR THE HIGHEST VALUE CRITICAL FALL HEIGHT OF PLAY EQUIPMENT INSTALLED WITHIN EACH SECTION.
 - ALL JOINS BETWEEN SHOCKPAD TILES ARE TO BE GLUED USING ADHESIVE JOINT SEALANT (Sikaflex®221 OR EQUIVALENT).



C:\Users\ladyanna\OneDrive - MRCAM - Projects\CurrentStd Dwg\A3-09730BB.dwg

				SURVEYED BY	DRAWN	SIGNED	DATE	ASSET OWNER			SHEET 1 OF 1	
				SURVEY FILE No	DESIGNED	SIGNED	DATE	ORIGINALLY SIGNED BY 03/03/2021 JASON COCKER DATE			WORKS JOB No.	
					CHECKED	SIGNED	DATE				DRAWING No.	
B	07/2026	MINOR AMENDMENTS TO NOTES & DRAWINGS	APPVD	LEVEL DATUM	MANAGER / CO-ORDINATOR			CERTIFIED			AMEND.	
A	09/2020	ORIGINAL ISSUE		A.H.D.							DRAWING No.	
NO.	DATE	DESCRIPTION	APPVD	HOR. DATUM / DATE							A3-09730	
AMENDMENTS AND REVISIONS				MGA 94/2020							B	